


# GUIDE TO WATER STORAGE FOR FIRE PROTECTION

## Attachment G-1

Santa Cruz County requires a minimum of 10,000 gallons of water storage and a fire department hydrant to access the water for all new residential, non-residential and building additions of more than 500 square feet. (Exception: If an approved municipal water system fire hydrant, is located within 600' of structure, then a private water supplied hydrant system is not required.) Note: All new dwellings require the installation of a residential fire sprinkler system. Hydrant location: To be a minimum of 50' and a maximum of 150' from the protected structures. The hydrant is to be located a minimum of 6' or a maximum of 8' from the edge of the road, driveway or turnout. A turnout is required if the driveway or road is less than 18' in width to allow additional fire apparatus to pass. Questions regarding the location of the fire hydrant will be addressed by the Fire Code Official.

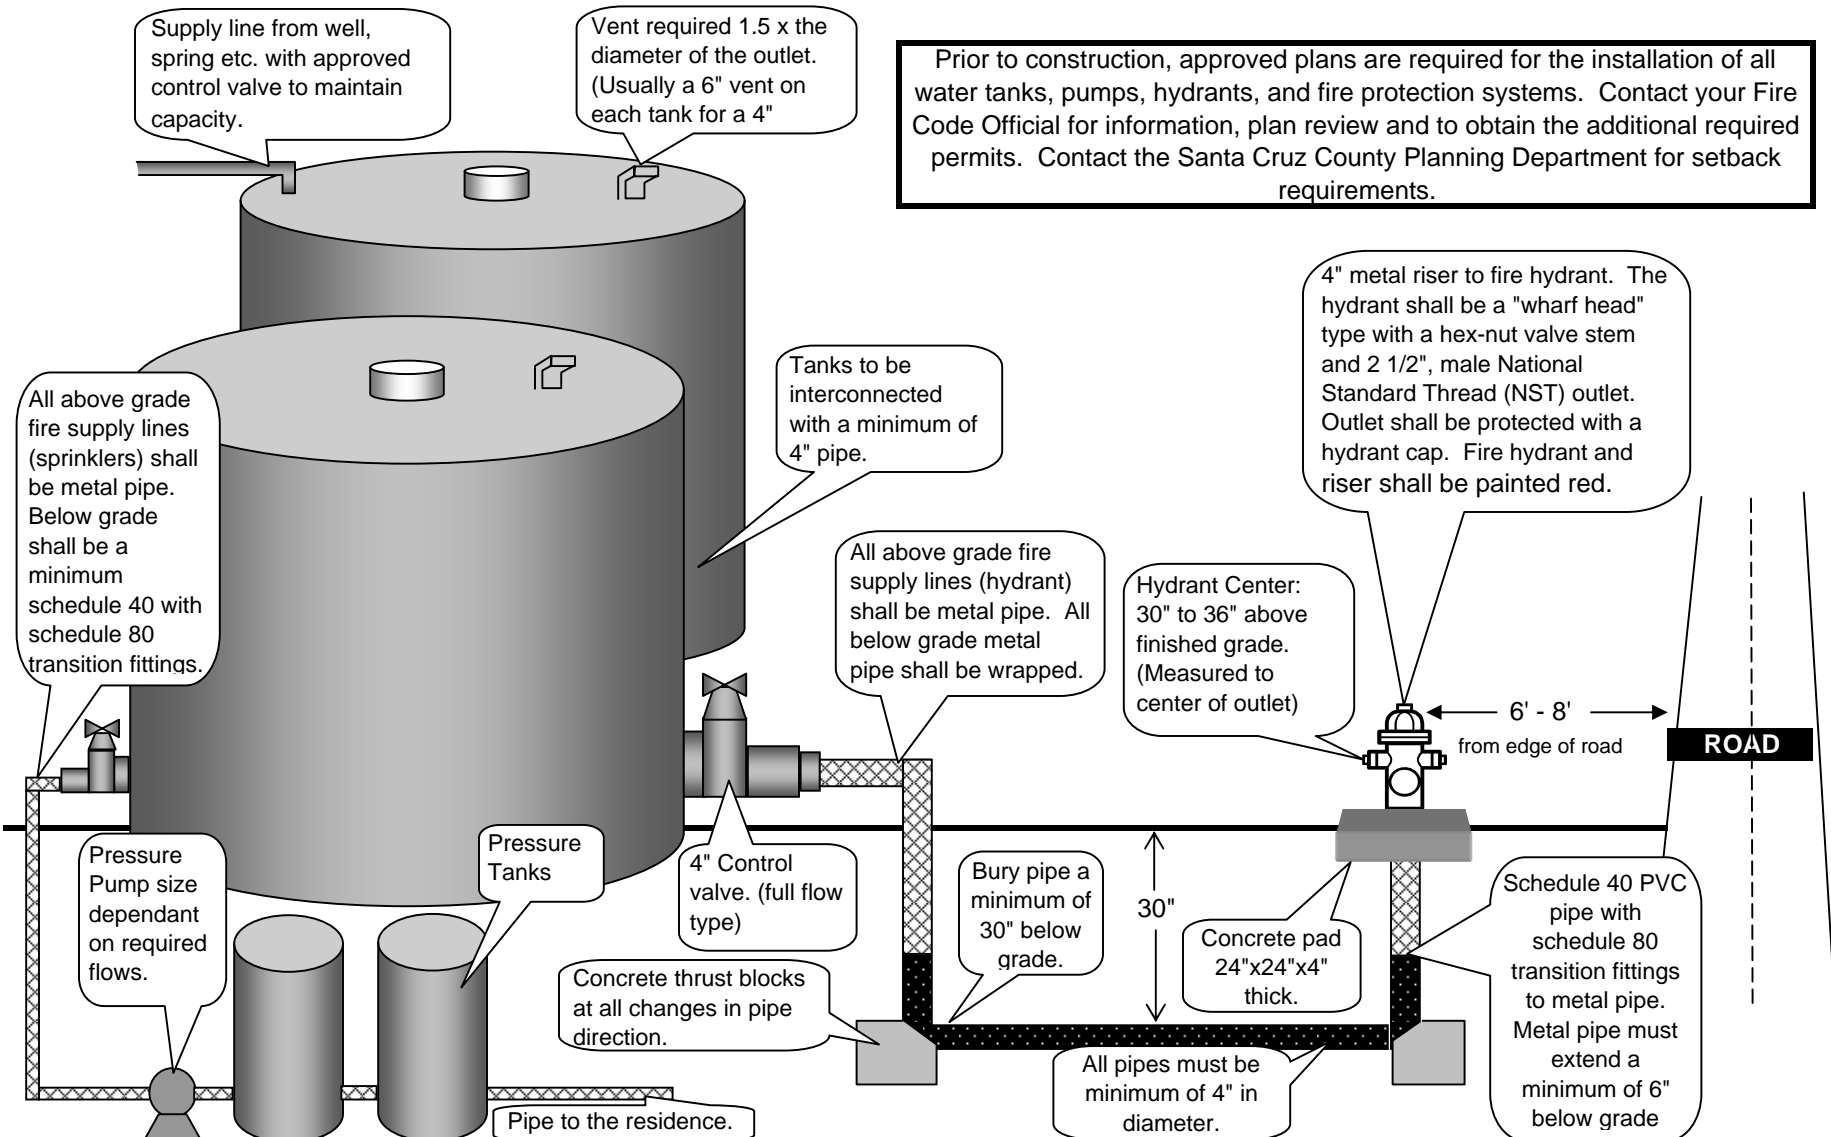

# GUIDE TO WATER STORAGE FOR FIRE PROTECTION

## Attachment G-2

Santa Cruz County requires a minimum of 10,000 gallons of water storage and a fire department hydrant to access the water for all new residential, non-residential and building additions of more than 500 square feet. (Exception: If an approved municipal water system fire hydrant, is located within 600' of structure, then a private water supplied hydrant system is not required.) Note: All new dwellings require the installation of a residential fire sprinkler system. Hydrant location: To be a minimum of 50' and a maximum of 150' from the protected structures. The hydrant is to be located a minimum of 6' or a maximum of 8' from the edge of the road, driveway or turnout. A turnout is required if the driveway or road is less than 18' in width to allow additional fire apparatus to pass. Questions regarding the location of the fire hydrant will be addressed by the Fire Code Official.

